



IECEx Certificate of Conformity

INTERNATIONAL ELECTROTECHNICAL COMMISSION IEC Certification System for Explosive Atmospheres

for rules and details of the IECEx Scheme visit www.iecex.com

Certificate No.:	IECEx ULD 14.0004X	Page 1 of 6	Certificate history:
Status:	Current	Issue No: 4	Issue 3 (2018-06-11) Issue 2 (2017-09-29) Issue 1 (2015-05-11) Issue 0 (2015-03-03)
Date of Issue:	2019-11-25		
Applicant:	European Safety Systems Limited Units 18 & 20 Impress House Mansell Rd. Acton, London W3 7QH GB United Kingdom United Kingdom		
Equipment:	D2xS1 (sounder) D2xC1 (sounder beacon) D2xB1 (beacon) D2xC2 (sounder beacon) D2xJ1 (junction box)		
Optional accessory:			
Type of Protection:	Non-Sparking "nA' and Dust Ignition Protection by Enclosure "tc"		
Marking:	Ex nA IIC T6/T4/T3/T2/T1 Gc Ex tc IIIC T55°/75°C/80°C/85°C/90°C/95°C/105°C/110°C Dc Please see Annex for additional temperature range information.		

Approved for issue on behalf of the IECEx
Certification Body:

Katy A. Holdredge

Position:

Senior Staff Engineer

Signature:
(for printed version)

Date:

2019-11-25

1. This certificate and schedule may only be reproduced in full.
2. This certificate is not transferable and remains the property of the issuing body.
3. The Status and authenticity of this certificate may be verified by visiting www.iecex.com or use of this QR Code.



Certificate issued by:

UL International DEMKO A/S
Borupvang 5A
DK-2750 Ballerup
Denmark





IECEx Certificate of Conformity

Certificate No.: **IECEx ULD 14.0004X**

Page 2 of 6

Date of issue: 2019-11-25

Issue No: 4

Manufacturer: **European Safety Systems Limited**
Units 18 & 20
Impress House
Mansell Rd.
Acton, London W3 7QH GB
United Kingdom
United Kingdom

Additional manufacturing locations:

This certificate is issued as verification that a sample(s), representative of production, was assessed and tested and found to comply with the IEC Standard list below and that the manufacturer's quality system, relating to the Ex products covered by this certificate, was assessed and found to comply with the IECEx Quality system requirements. This certificate is granted subject to the conditions as set out in IECEx Scheme Rules, IECEx 02 and Operational Documents as amended

STANDARDS :

The equipment and any acceptable variations to it specified in the schedule of this certificate and the identified documents, was found to comply with the following standards

IEC 60079-0:2011 Explosive atmospheres - Part 0: General requirements
Edition:6.0

IEC 60079-15:2010 Explosive atmospheres - Part 15: Equipment protection by type of protection "n"
Edition:4

IEC 60079-31:2013 Explosive atmospheres - Part 31: Equipment dust ignition protection by enclosure "t"
Edition:2

This Certificate **does not** indicate compliance with safety and performance requirements other than those expressly included in the Standards listed above.

TEST & ASSESSMENT REPORTS:

A sample(s) of the equipment listed has successfully met the examination and test requirements as recorded in:

Test Report:

[DK/ULD/ExTR14.0009/04](#)

Quality Assessment Report:

[GB/SIR/QAR06.0020/08](#)



IECEx Certificate of Conformity

Certificate No.: **IECEx ULD 14.0004X**

Page 3 of 6

Date of issue: 2019-11-25

Issue No: 4

EQUIPMENT:

Equipment and systems covered by this Certificate are as follows:

D2xS1 (sounder) comprises an aluminium enclosure housing components to generate selectable tones. The enclosure is sealed with o-rings to prevent ingress of dust or water. Up to two M20 threaded entries may be provided for installation of appropriately certified cable entry devices by the end user.

D2xC1X05 (sounder beacon) is the same aluminium housing as the D2xS1, except on one end the beacon assembly is mounted. The lamp is protected by a lens and wire guard. The lens and retaining ring screws are sealed with o-rings to prevent ingress of dust or water. Additional electrical components associated with the operation of the 5 Joule beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xC1X10 (sounder beacon) is the same aluminium housing as the D2xS1, except on one end the beacon assembly is mounted. The lamp is protected by a lens and wire guard. The lens and retaining ring screws are sealed with o-rings to prevent ingress of dust or water. Additional electrical components associated with the operation of the 10 Joule beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xB1X05 (beacon) comprises an aluminium enclosure housing components to generate visual outputs. The enclosure is sealed with o-rings to prevent ingress of dust and water. Up to 7 M20, $\frac{1}{2}$ NPT or $\frac{3}{4}$ NPT threaded entries may be provided for installation of appropriately certified cable entry devices by the end user. The lamp is protected by a lens and an optional wire guard. Additional electrical components associated with the operation of the 5 Joule beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xB1X10 (beacon) is the same aluminium housing enclosure as the D2xB1X05. The lamp is protected by a lens and an optional wire guard. Additional electrical components associated with the operation of the 10 Joule beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xB1LD2 (beacon) is the same aluminium housing enclosure as the D2xB1X05. The lamp is protected by a lens and an optional wire guard. Additional electrical components associated with the operation of the LED beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xB1LD3 (beacon) is the same aluminium housing enclosure as the D2xB1X05. The lamp is protected by a lens and an optional wire guard. Additional electrical components associated with the operation of the LED beacon, are installed within the housing and reflected by the nomenclature with "DC" followed by the voltage.

D2xC2X05 (sounder beacon) is the same aluminium housing as the D2xB1X05, coupled with the D2xS1 aluminium enclosure. Two brass connectors with locknuts secure the two housings together with a neoprene foam seal providing the ingress protection. Additional electrical components associated with the operation of the 5 Joule beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xC2X10 (sounder beacon) is the same aluminium housing as the D2xB1X05, coupled with the D2xS1 aluminium enclosure. Two brass connectors with locknuts secure the two housings together with a neoprene foam seal providing the ingress protection. Additional electrical components associated with the operation of the 10 Joule beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xC2LD2 (sounder beacon) is the same aluminium housing as the D2xB1X05, coupled with the D2xS1 aluminium enclosure. Two brass connectors with locknuts secure the two housings together with a neoprene foam seal providing the ingress protection. Additional electrical components associated with the operation of the LED beacon, are installed within the housing and reflected by the nomenclature with "AC or DC" followed by the voltage.

D2xC2LD3 (sounder beacon) is the same aluminium housing as the D2xB1X05, coupled with the D2xS1 aluminium enclosure. Two brass connectors with locknuts secure the two housings together with a neoprene foam seal providing the ingress protection. Additional electrical components associated with the operation of the LED beacon, are installed within the housing and reflected by the nomenclature with "DC" followed by the voltage.

(see Equipment Continued)

SPECIFIC CONDITIONS OF USE: YES as shown below:

- End user shall adhere to the manufacturer's installation and instruction when performing housekeeping to avoid the potential for hazardous electrostatic charges during cleaning, by using a damp cloth.
- Not to be mounted with the horn facing upwards. Refer to Manufacturer's Instructions.
- The equipment shall only be used in end use with appropriately certified cable entry devices and blanking plugs.



IECEx Certificate of Conformity

Certificate No.: **IECEx ULD 14.0004X**

Page 4 of 6

Date of issue: 2019-11-25

Issue No: 4

Equipment (continued):

D2xJ1T(Junction Box) is the same aluminium housing as the D2xB1X05 with the junction box lid replacing the lens assembly lid. The enclosure is provided with a 12 Way Terminal Block.

D2xJ1D(Junction Box) is the same aluminium housing as the D2xB1X05 with the junction box lid replacing the lens assembly lid. The enclosure is provided with a DIN rail for installation for up to 12 AKZ 2.5 terminal blocks, and 4 AKE 2.5 Terminal blocks.

D2xB1XH1DC024 (beacon) is the same aluminium housing enclosure as the D2xB1X05. The lamp is protected by a lens and an optional wire guard. The electronics are similar to that of D2xB1X05DC024, with the addition of a low voltage sub board to control flash rate timing.

D2xB1XH2DC024 (beacon) is the same aluminium housing enclosure as the D2xB1X05. The lamp is protected by a lens and an optional wire guard. The electronics are similar to that of D2xB1X10DC024, with the addition of a low voltage sub board to control flash rate timing.

D2xC2XH1DC024 (sounder beacon) is the same aluminium housing as the D2xB1X05, coupled with the D2xS1 aluminium enclosure. Two brass connectors with locknuts secure the two housings together with a neoprene foam seal providing the ingress protection. The model utilizes the D2xB1XH1DC024 beacon coupled with D2xS1DC024.

D2xC2XH2DC024 (sounder beacon) is the same aluminium housing as the D2xB1X05, coupled with the D2xS1 aluminium enclosure. Two brass connectors with locknuts secure the two housings together with a neoprene foam seal providing the ingress protection. The model utilizes the D2xB1XH2DC024 beacon coupled with D2xS1DC024.

Please see Annex for additional information.



IECEx Certificate of Conformity

Certificate No.: **IECEx ULD 14.0004X**

Page 5 of 6

Date of issue: 2019-11-25

Issue No: 4

DETAILS OF CERTIFICATE CHANGES (for issues 1 and above)

Issue 1: Correction of the Nomenclature voltage detail to include AC or DC0 as applicable.

Correction of the Conditions of Certification to match installation instructions.,

Issue 2: Addition of D2xB1 beacons, D2xC2 sounder beacon combinations and D2xJ1 Junction boxes.

Issue 3: Adds new models and sub board assembly.

Issue 4: Adds two new models (new LED driver boards), D2XB1LD3-DC024 and D2XC2LD3-DC024 and updates some of the existing models.



IECEx Certificate of Conformity

Certificate No.: **IECEx ULD 14.0004X**

Page 6 of 6

Date of issue: 2019-11-25

Issue No: 4

Additional information:

See Annex for additional Nomenclature details.

Annex:

[Annex to IECEx ULD 14.0004X Issue 4.pdf](#)



IECEx Certificate of Conformity

Certificate No.:

IECEx ULD 14.0004X

Issue No.:4

Page 1 of 6

TYPE DESIGNATION

Nomenclature

Model	Beacon energy (Joules)	Rated Voltage	Suffix
D2xS1 (Sounder)		AC115 AC230 DC024 DC048	
D2xC1X (sounder beacon)	05, 10	AC115 AC230 DC024 DC048	
D2xB1X (beacon)	05	DC024 DC048 AC115 AC230	Up to 4 alpha numeric characters, not associated with equipment certification
		DC024 DC048 AC115 AC230	
D2xB1LD2 (LED beacon)	-	DC024	
	-	AC115	
	-	AC230	
D2xB1LD3 (LED beacon)	-	DC024	
D2xC2X	05	DC024 DC048 AC115 AC230	
		DC024 DC048 AC115 AC230	
		DC024 DC048 AC115 AC230	
		DC024 DC048 AC115 AC230	
D2xC2LD2	-	DC024 DC048 AC115 AC230	
		DC024 DC048 AC115 AC230	
D2xC2LD3 (LED beacon)	-	DC024	
D2xJ1T	-	-	
D2xJ1D	-	-	Up to 4 alpha numeric characters, not associated with equipment certification
D2xB1XH1	-	DC024	
D2xB1XH2	-	DC024	
D2xC2XH1	-	DC024	
D2xC2XH2	-	DC024	



IECEx Certificate of Conformity

Certificate No.:

IECEx ULD 14.0004X

Issue No.:4

Page 2 of 6

Electrical Ratings:

Model	Electrical Ratings			
	DC	AC	Hz	Max. Amps, mA
D2xS1DC024	10-30	-	-	313
D2xS1DC048	38-58	-	-	218
D2xS1AC115	-	103.5-126.5	60	91
D2xS1AC230	-	207-253	50	72
D2xC1X05DC024	20-28	-	-	521
D2xC1X05DC048	42-58	-	-	328
D2xC1X05AC115	-	115-125	60	183
D2xC1X05AC230	-	215-250	50	77
D2xC1X10DC024	20-28	-	-	876
D2xC1X10DC048	42-58	-	-	475
D2xC1X10AC115	-	115-125	60	343
D2xC1X10AC230	-	215-250	50	115
D2xB1X05DC024	20-28	-	-	296
D2xB1X05DC048	48	-	-	145
D2xB1X05AC115	-	115-120	50/60	80
D2xB1X05AC230	-	220-230	50/60	30
D2xB1X10DC024	20-28	-	-	609
D2xB1X10DC048	48	-	-	260
D2xB1X10AC115	-	115-120	50/60	185
D2xB1X10AC230	-	220-230	50/60	107
D2xB1LD2DC024	18-54	-	-	346
D2xB1LD2AC115	-	115-120	50/60	102.4
D2xB1LD2AC230	-	220-230	50/60	75
D2xB1LD3DC024	16-33	-	-	528
D2xC2X05DC024	20-28	-	-	296+303
D2xC2X05DC048	48	-	-	145+218
D2xC2X05AC115	-	115-120	50/60	80+91
D2xC2X05AC230	-	220-230	50/60	30+72
D2xC2X10DC024	20-28	-	-	609+313
D2xC2X10DC048	48	-	-	260+218
D2xC2X10AC115	-	115-120	50/60	185+91
D2xC2X10AC230	-	220-230	50/60	107+72
D2xC2LD2DC024	24	-	-	346+313
D2xC2LD2DC048	48	-	-	115+218
D2xC2LD2AC115	-	115-120	50/60	102.4+91
D2xC2LD2AC230	-	220-230	50/60	75+72
D2xC2LD3DC024	16-33	-	-	528+250
D2xJ1T	54 Max	230 Max	50/60	10A Max
D2xJ1D	54 Max	230 Max	50/60	10A Max
D2xB1XH1DC024	20-28	-	-	296
D2xB1XH2DC024	20-28	-	-	609
D2xC2XH1DC024	20-28	-	-	449
D2xC2XH2DC024	20-28	-	-	785



IECEx Certificate of Conformity

Certificate No.:

IECEx ULD 14.0004X

Issue No.:4

Page 3 of 6

Temperature range and class for each Model Series:

Model	Type of protection	Temperature Class	Associated Maximum Ambient Temperature
D2XS1	Ex nA IIC	T4 (<135°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T90°C	-40°C ≤ Tamb ≤ +50°C
D2XC1X05	Ex nA IIC	T2 (<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T90°C	-40°C ≤ Tamb ≤ +50°C
D2XC1X10	Ex nA IIC	T2 (<300°C)	-40°C ≤ Tamb ≤ +40°C
	Ex nA IIC	T1 (<450°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T110°C	-40°C ≤ Tamb ≤ +50°C
D2xB1LD2	Ex nA IIC	T4(<135°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T75°C	-40°C ≤ Tamb ≤ +50°C
D2xB1LD3	Ex nA IIC	T4(<135°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T75°C	-40°C ≤ Tamb ≤ +50°C
D2xB1X05DC024	Ex nA IIC	T2(<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T80°C	-40°C ≤ Tamb ≤ +50°C
D2xB1X05DC048 D2xB1X05AC115 D2xB1X05AC230	Ex nA IIC	T3(<200°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T95°C	-40°C ≤ Tamb ≤ +50°C
D2xB1X10DC024	Ex nA IIC	T1(<450°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T105°C	-40°C ≤ Tamb ≤ +50°C
D2xB1X10DC048 D2xB1X10AC115 D2xB1X10AC230	Ex nA IIC	T2(<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T95°C	-40°C ≤ Tamb ≤ +50°C
D2xC2X05DC024	Ex nA IIC	T3(<200°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T75°C	-40°C ≤ Tamb ≤ +50°C
D2xC2X05DC048 D2xC2X05AC115 D2xC2X05AC230	Ex nA IIC	T3(<200°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T95°C	-40°C ≤ Tamb ≤ +50°C
D2xC2X10DC024	Ex nA IIC	T2(<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T85°C	-40°C ≤ Tamb ≤ +50°C
D2xC2X10DC048 D2xC2X10AC115 D2xC2X10AC230	Ex nA IIC	T2(<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T95°C	-40°C ≤ Tamb ≤ +50°C



IECEx Certificate of Conformity

Certificate No.:

IECEx ULD 14.0004X

Issue No.:4

Page 4 of 6

Temperature range and class for each Model Series (Cond.):

Model	Type of protection	Temperature Class	Associated Maximum Ambient Temperature
D2xC2LD2	Ex nA IIC	T4(<135°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T75°C	-40°C ≤ Tamb ≤ +50°C
D2xC2LD3	Ex nA IIC	T4(<135°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T75°C	-40°C ≤ Tamb ≤ +50°C
D2xJ1T	Ex nA IIC	T6(<85°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T55°C	-40°C ≤ Tamb ≤ +50°C
D2xJ1D	Ex nA IIC	T6(<85°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T55°C	-40°C ≤ Tamb ≤ +50°C
D2xB1XH1DC024	Ex nA IIC	T2(<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T80°C	-40°C ≤ Tamb ≤ +50°C
D2xB1XH2DC024	Ex nA IIC	T1 (<450°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T105°C	-40°C ≤ Tamb ≤ +50°C
D2xC2XH1DC024	Ex nA IIC	T3(<200°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T75°C	-40°C ≤ Tamb ≤ +50°C
D2xC2XH2DC024	Ex nA IIC	T2(<300°C)	-40°C ≤ Tamb ≤ +50°C
	Ex tc IIIC	T85°C	-40°C ≤ Tamb ≤ +50°C



IECEx Certificate of Conformity

Certificate No.:

IECEx ULD 14.0004X


Issue No.:4

Page 5 of 6


MARKING

Marking has to be readable and indelible; it has to include the following indications:


Note: Label 1 & 2 are both applied to the appropriate equipment incorporating relevant protection concept information, warning and cautionary markings.

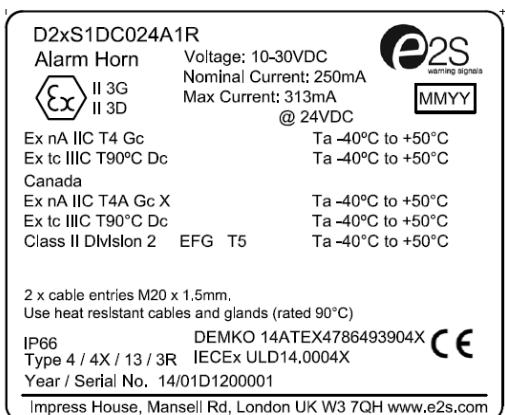


D2xS1 PRODUCT LABEL 1

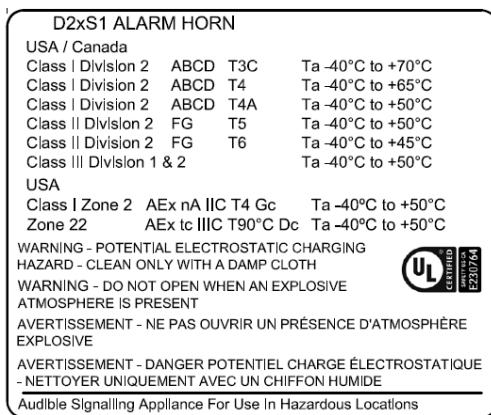

D2xS1 PRODUCT LABEL 2

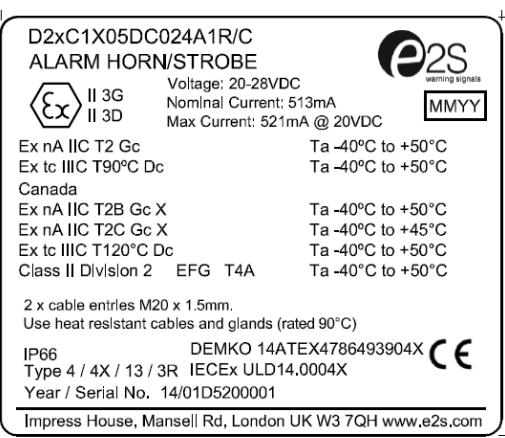

D2xC1X05 PRODUCT LABEL 1

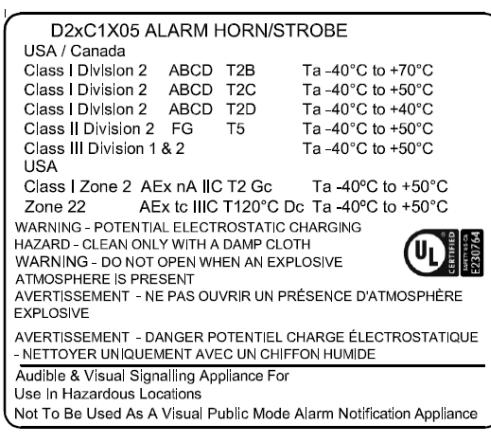

D2xC1X05 PRODUCT LABEL 2



IECEx Certificate of Conformity

Certificate No.:

IECEx ULD 14.0004X

Issue No.:4

Page 6 of 6

D2xC1X10DC024R/C ALARM HORN/STROBE Voltage: 20-28VDC Nominal Current: 876mA Max Current: 876mA @ 20VDC Ex nA IIC T1 Gc Ta -40°C to +50°C Ex nA IIC T2 Gc Ta -40°C to +40°C Ex tc IIC T110°C Dc Ta -40°C to +50°C Canada Ex nA IIC T1 Gc X Ta -40°C to +50°C Ex nA IIC T2 Gc X Ta -40°C to +40°C Ex tc IIC T120°C Dc Ta -40°C to +50°C Class II Division 2 EFG T4A Ta -40°C to +50°C 2 x cable entries M20 x 1.5mm, Use heat resistant cables and glands (rated 90°C) IP66 DEMKO 14ATEX4786493904X CE Type 4 / 4X / 13 / 3R IECEx ULD14.0004X Year / Serial No. 14/01D6200001 Impress House, Mansell Rd, London UK W3 7QH www.e2s.com		D2xC1X10 ALARM HORN/STROBE USA / Canada Class I Division 2 ABCD T1 Ta -40°C to +70°C Class I Division 2 ABCD T2 Ta -40°C to +50°C Class II Division 2 FG T4A Ta -40°C to +50°C Class II Division 2 FG T5 Ta -40°C to +40°C Class III Division 1 & 2 USA Ta -40°C to +50°C Class I Zone 2 AEx nA IIC T1 Gc Ta -40°C to +50°C Class I Zone 2 AEx nA IIC T2 Gc Ta -40°C to +40°C Zone 22 AEx tc IIC T120°C Dc Ta -40°C to +50°C WARNING - POTENTIAL ELECTROSTATIC CHARGING HAZARD - CLEAN ONLY WITH A DAMP CLOTH WARNING - DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT AVERTISSEMENT - NE PAS OUVRIR UN PRÉSENCE D'ATMOSPHÈRE EXPLOSIVE AVERTISSEMENT - DANGER POTENTIEL CHARGE ÉLECTROSTATIQUE - NETTOYER UNIQUEMENT AVEC UN CHIFFON HUMIDE Audible & Visual Signalling Appliance For Use In Hazardous Locations Not To Be Used As A Visual Public Mode Alarm Notification Appliance
--	--	---

D2xC1X10 PRODUCT LABEL 1

D2xC1X10 PRODUCT LABEL 2

WARNING: DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT DO NOT OPEN WHEN ENERGISED POTENTIAL ELECTROSTATIC CHARGING HAZARD - CLEAN ONLY WITH A DAMP CLOTH HIGH VOLTAGE SHOCK HAZARD. WAIT 5 MINUTES AFTER REMOVING POWER BEFORE OPENING THE ENCLOSURE DO NOT PAINT	AVERTISSEMENT: NE PAS OUVRIR UN PRESENCE D'ATMOSPHÈRE EXPLOSIVE NE PAS OUVRIR ENERGIE DANGER POTENTIEL CHARGE ÉLECTROSTATIQUE - NETTOYER UNIQUEMENT AVEC UN CHIFFON HUMIDE HAUT TENSION, RISK DE CHOC. ATTENDEZ 5 MINUTES APRES AVOIR DEBRANCHE L'ALIMENTATION AVANT D'OUVRIR LA BOÎTIER NE PAS PEINTURER
--	---

D2xC2X05DC024 Voltage: 24VDC Special Application Max Current Combined Unit 449mA Range: 20-28VDC For detailed current & light output ratings, see instructions D211-00-601-IS-SC Cable entries: 2-off M20 & 1-off $\frac{1}{2}$ " NPT. Audible Appliance for use in Fire Alarm Systems - Public Mode SPL at 10 feet 103.6 dB(A) IP66 Type 4/4X/3R/13 Use Heat Resistant Cables and Glands (rated 95°C) NEC / CEC Class / Div Class I Division 2 ABCD T3 Ta -40°C to +50°C Class II Division 2 FG T5 Ta -40°C to +50°C Class II Division 2 FG T6 Ta -40°C to +40°C Class III Div 1 & 2 Ta -40°C to +50°C CEC Class / Zone Ex nA IIC T3 Gc Ta -40°C to +50°C Ex tc IIC 95°C Dc Ta -40°C to +50°C NEC Class / Zone Class I Zone 2 AEx nA IIC T3 Gc Ta -40°C to +50°C Zone 22 AEx tc IIC 95°C Dc Ta -40°C to +50°C Audible Signal Appliance for Use in Hazardous Locations Candelas 18.18cd 1Hz ; Flash Pulse 2.0ms UL LISTED E230764 FIRE / FEU Year / Serial No.: 17/1D72XXXXXX Impress House, Mansell Rd, London UK W3 7QH

D2xC2 / D2xJ1 PRODUCT LABEL 1

D2xB1 , D2xC2 and D2xJ1 Warning label

D2xB1X05DC024 Voltage: 24VDC Max Current: 296mA Range: 20-28VDC For detailed current & light output ratings, see instructions D211-00-201-IS-SC Cable entries: 2-off M20 x 1.5mm, 2-off $\frac{1}{2}$ " NPT & 1-off $\frac{3}{8}$ " NPT; IP66 DEMKO 14 ATEX 4786493904X Type 4 / 4X / 3R / 13 IECEx ULD 14.0004X Year / Serial No. 17/1D22XXXXXX Impress House, Mansell Rd, London UK W3 7QH
--

ATEX / IECEX Ex nA IIC T3 Gc Ta -40°C to +50°C Ex tc IIC 95°C Dc Ta -40°C to +50°C NEC / CEC Class / Div Class I Division 2 ABCD T3 Ta -40°C to +50°C Class I Division 2 FG T5 Ta -40°C to +50°C Class II Division 2 FG T6 Ta -40°C to +40°C Class III Div 1 & 2 Ta -40°C to +50°C Use Heat Resistant Cables and Glands (rated 85°C)

D2xB1 PRODUCT LABEL 1

D2xB1 PRODUCT LABEL 3

ROUTINE EXAMINATIONS AND TESTS

The xenon lamp assembly shall be routinely dielectrically strength tested. Tests shall be performed as described in IEC 60079-15 clause 6.5.1.

The D2xJ1 assembly shall be routinely dielectrically strength tested. The tests shall be performed as described in IEC 60079-15 clause 6.5.1.